


Exhibit 1
Flow Charts for Interconnection
NARUC
And
Mass. Electric

INTERCONNECTION REVIEW PROCESS

Fast-track Review Process:

Standard Review Process:


Step 1.

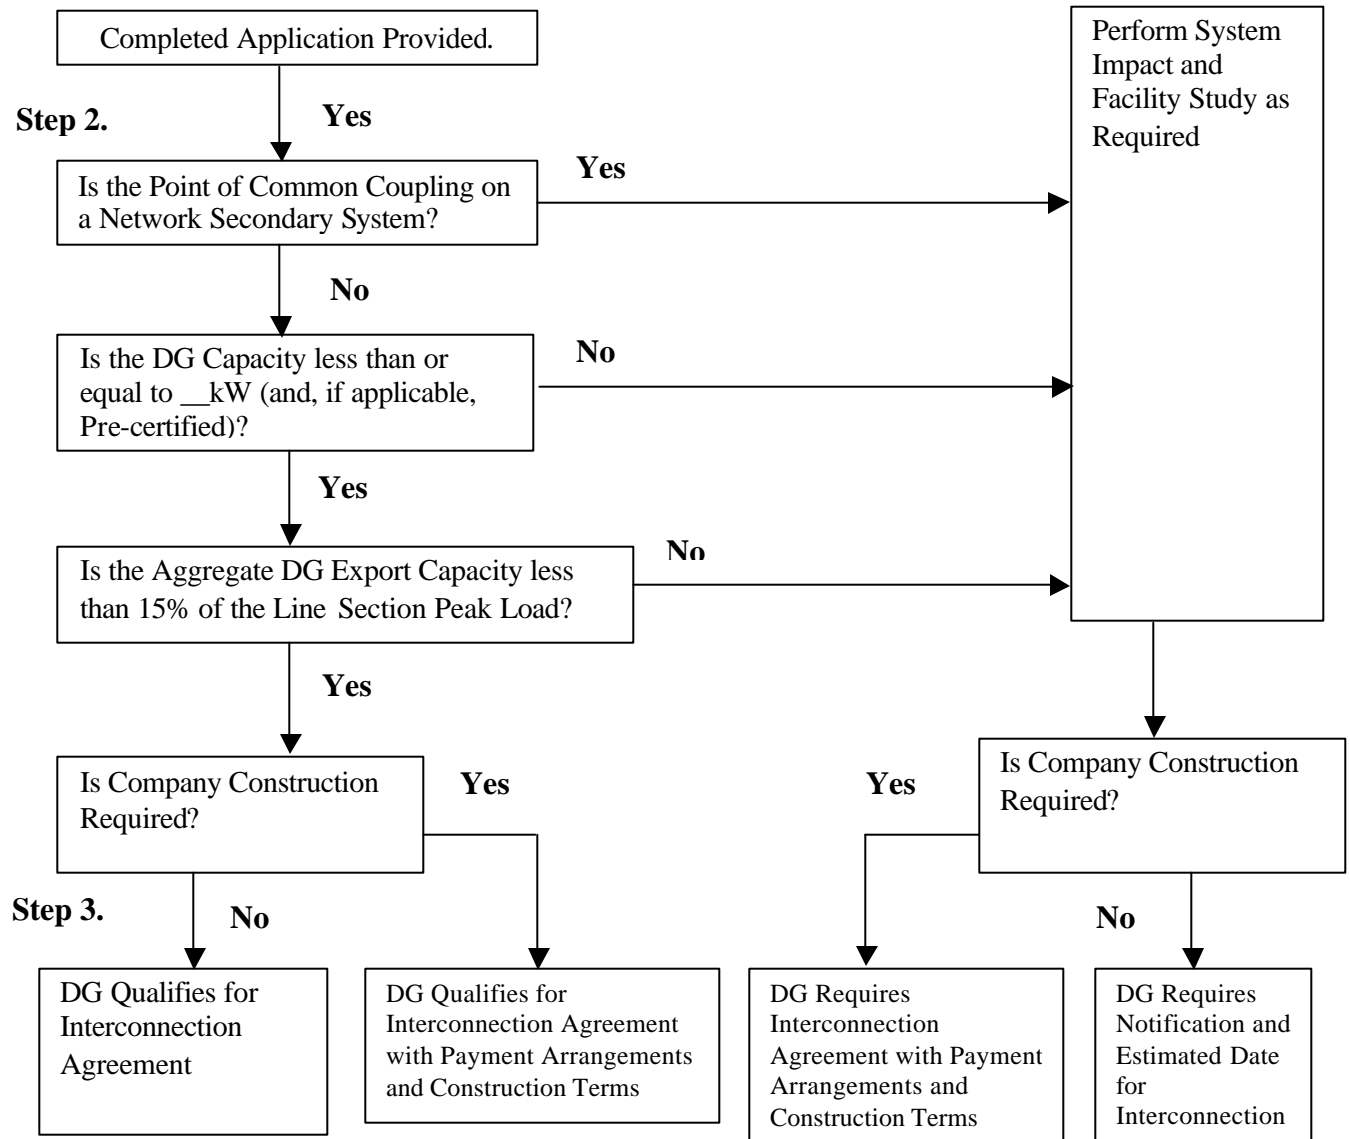

Step 4. Construction

Step 5. Connection, Testing, and Operation

MECo Process for Interconnection of Customer-owned Generators Rated at 10 kW or Less

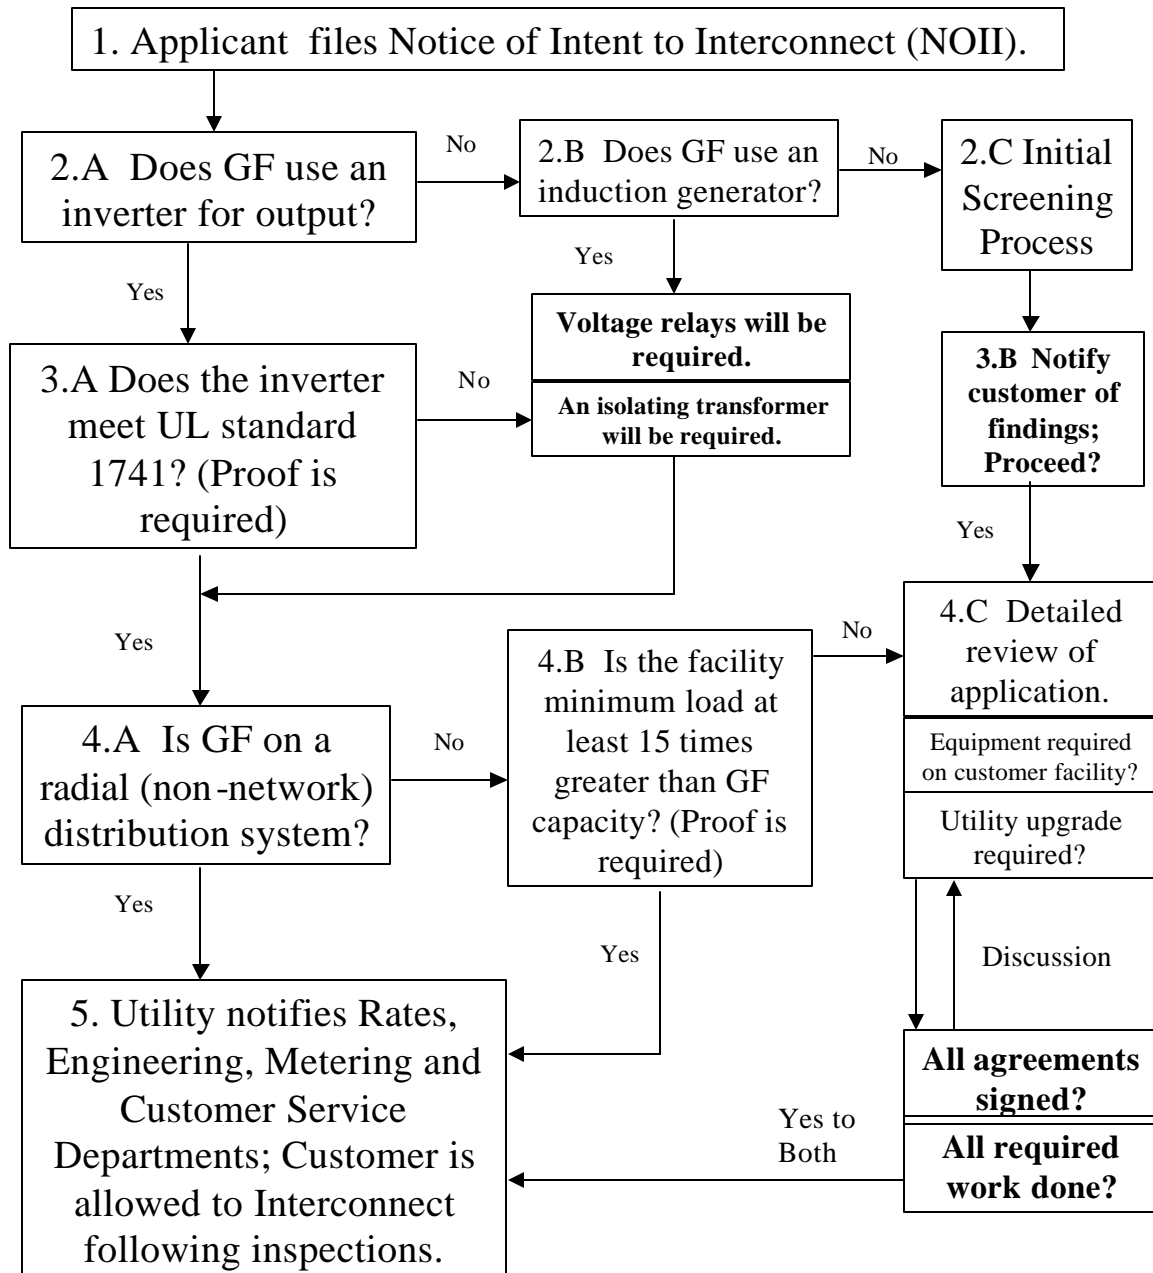

GF-PROC-JB-J19C.PPT

Massachusetts Electric Company
Nantucket Electric Company
D.T.E. Docket No. 02-38


Exhibit 2
Daily Load Profiles



National Grid

Load Profiles

Profile for Selected Accounts on 05/21/2002

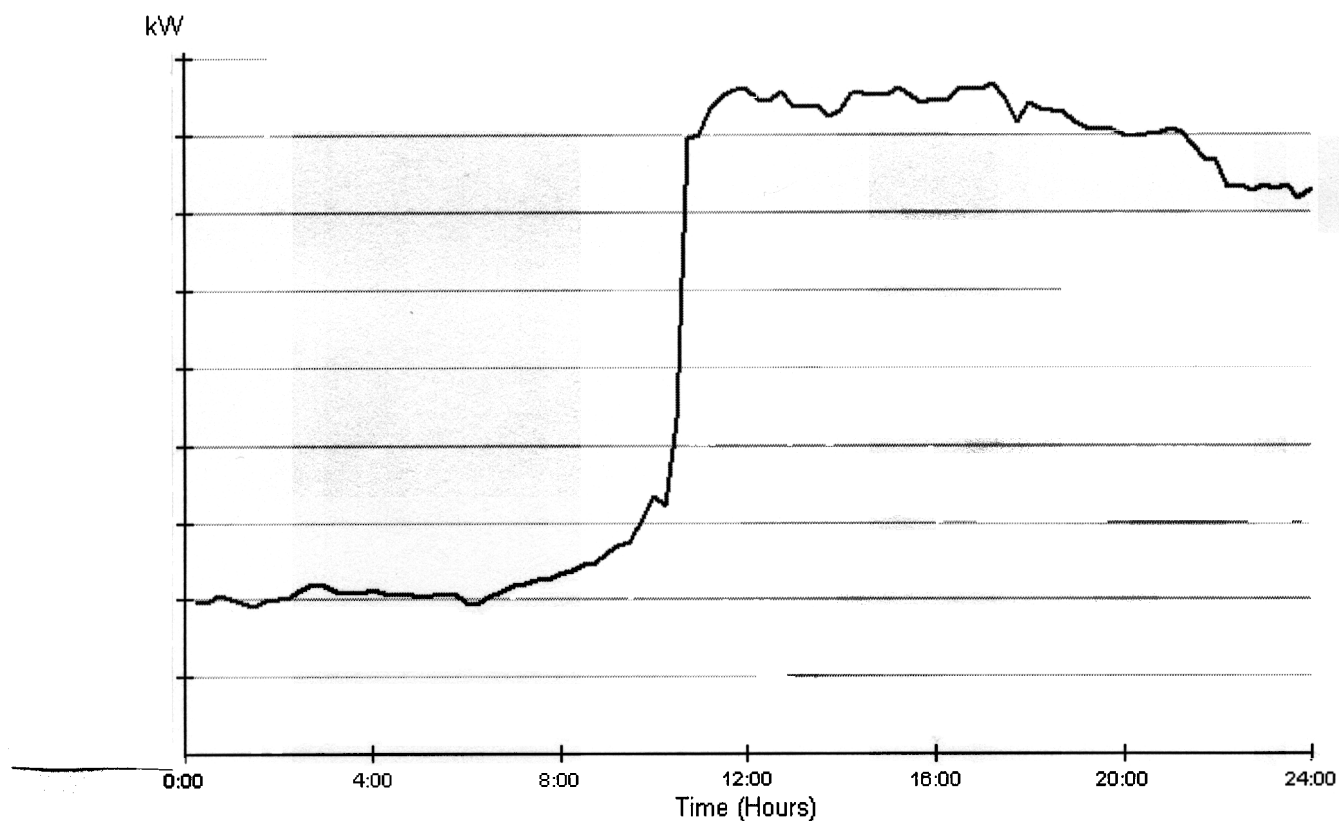


08/15/2002



Load Profiles

Profile for Selected Accounts on 06/19/2002

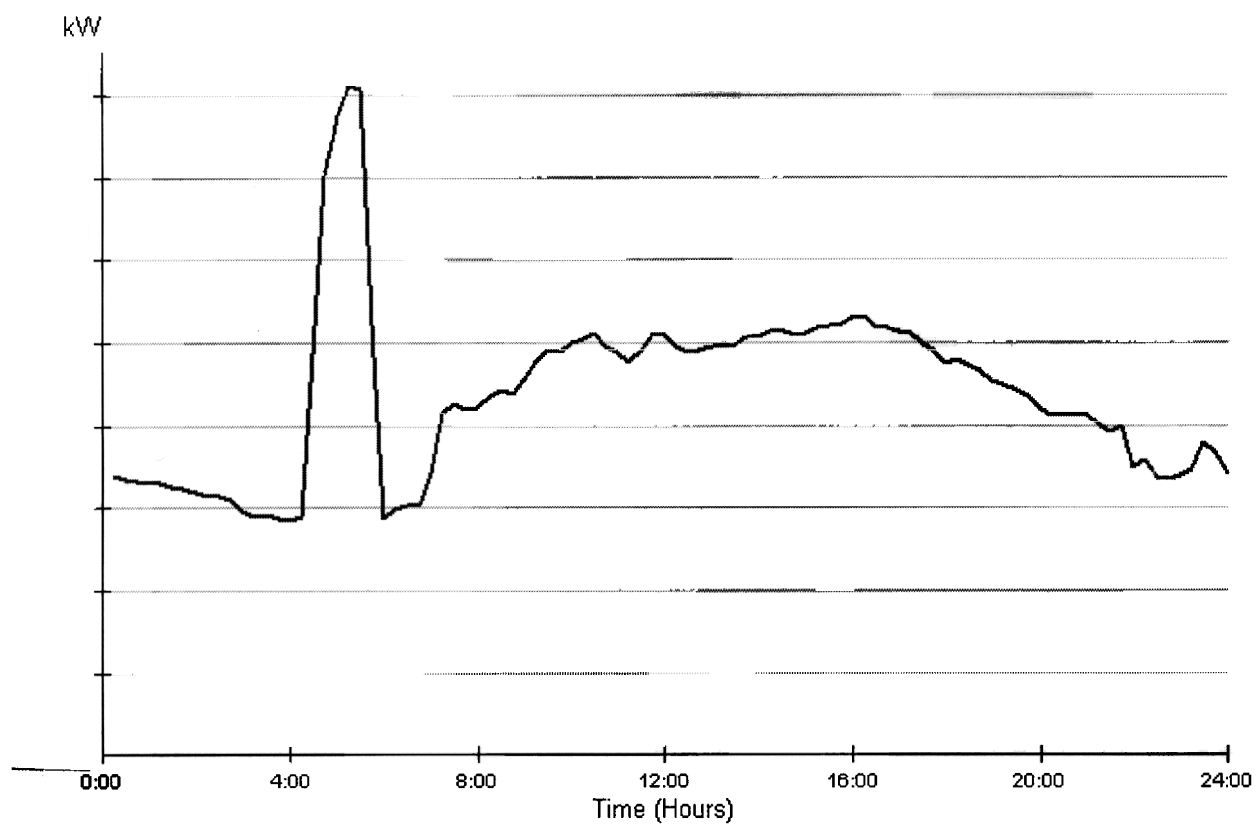


08/15/2002



National Grid

Load Profiles

Profile for Selected Accounts on 07/04/2002

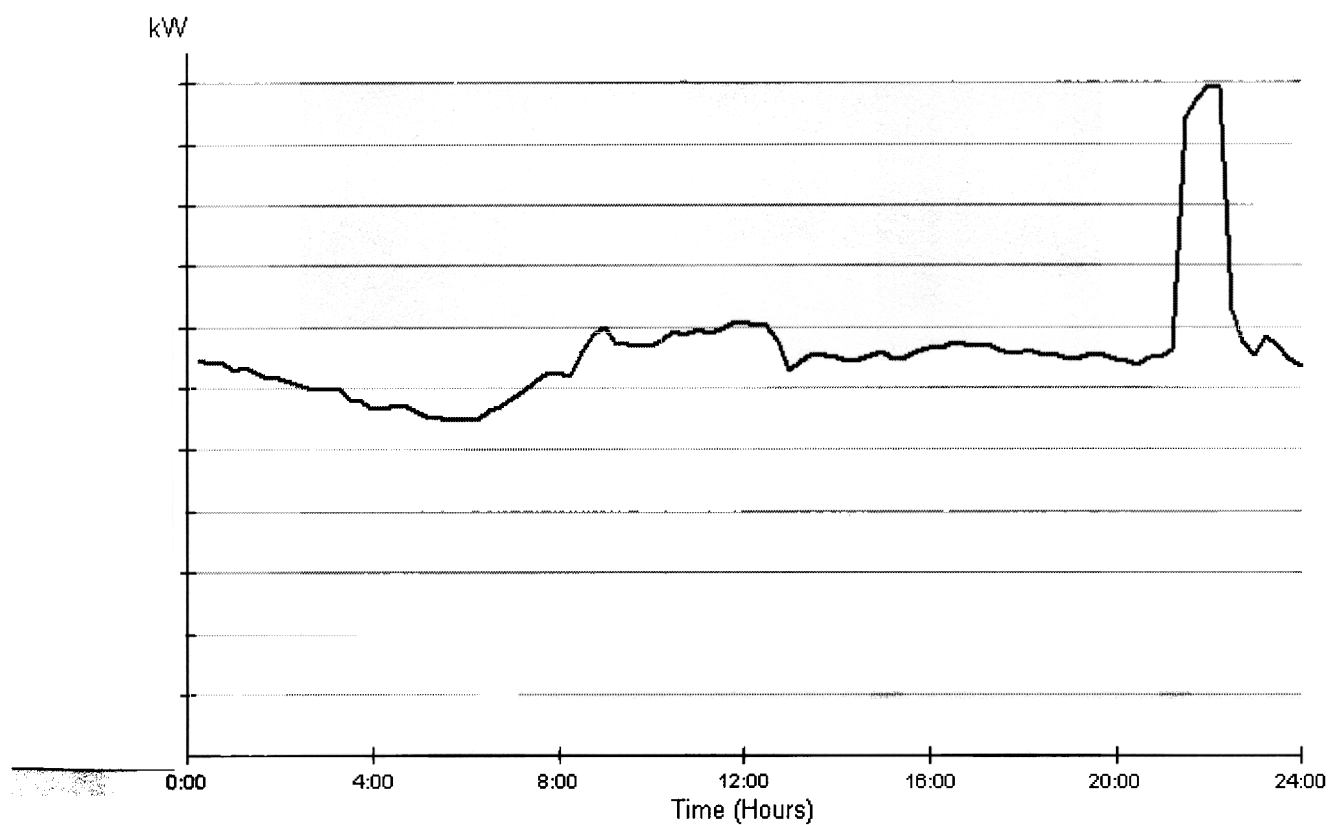


08/15/2002



National Grid

Load Profiles

Profile for Selected Accounts on 07/30/2002

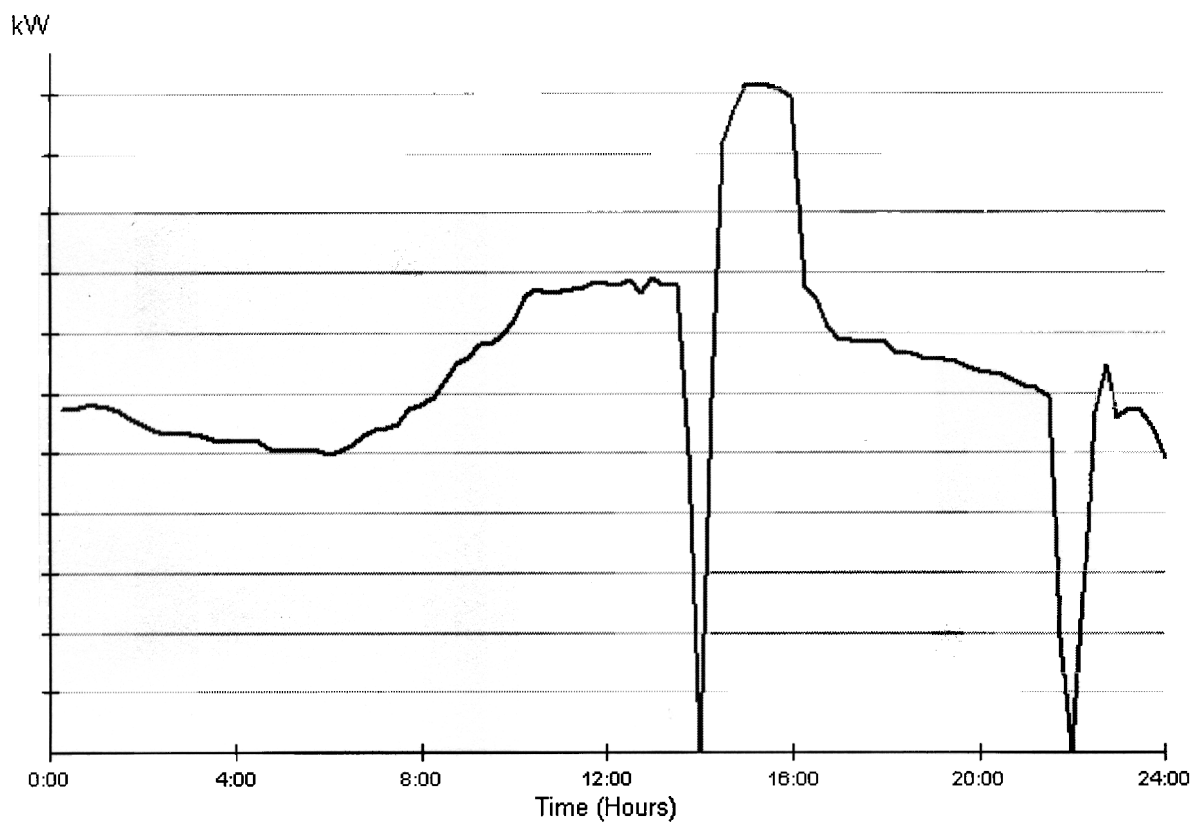

08/15/2002

Massachusetts Electric Company
Nantucket Electric Company
D.T.E. Docket No. 02-38


Exhibit 3

Average Daily Load Profile



Average Profiles

Profile for Account

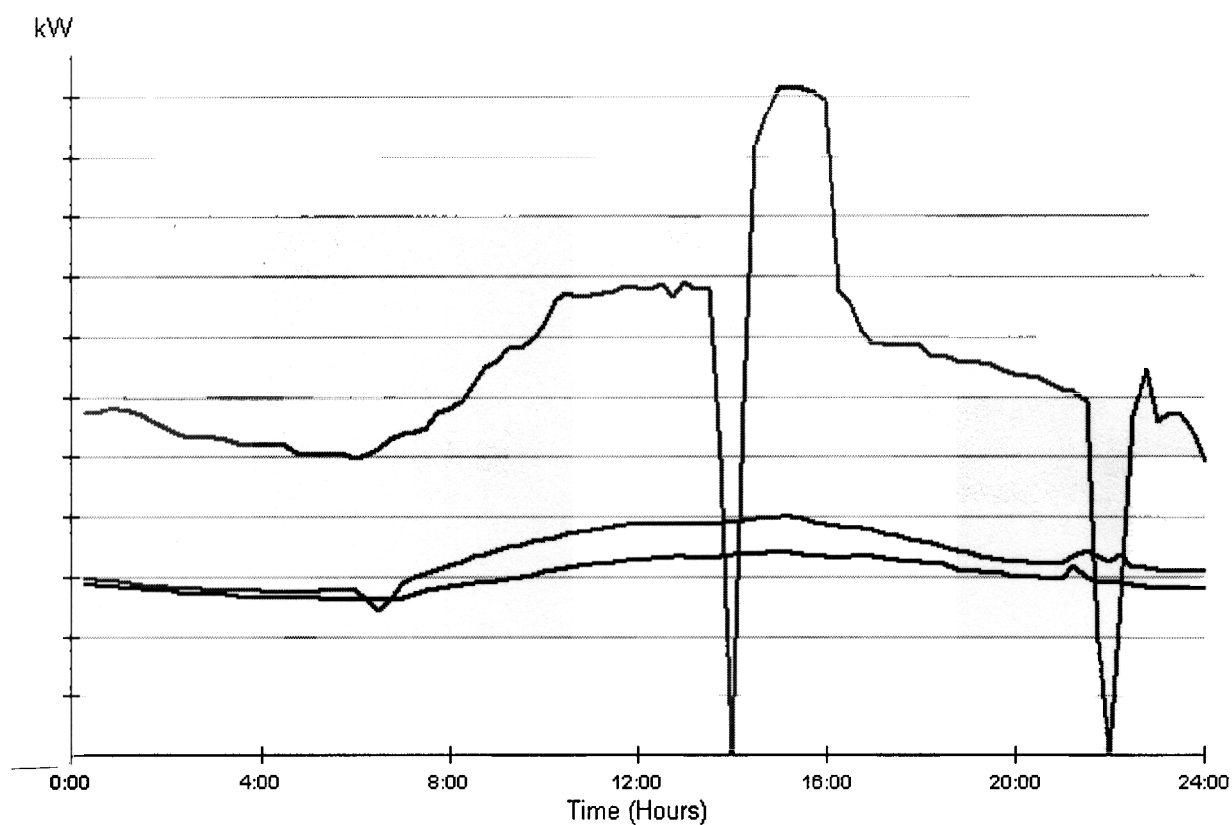


- Average Weekday
- Average Weekend
- Peak Day: 07/30/2002 15:15

Massachusetts Electric Company
Nantucket Electric Company
D.T.E. Docket No. 02-38

Exhibit 4

Load Reduction in Brockton Pilot

July 3rd Load Curtailment

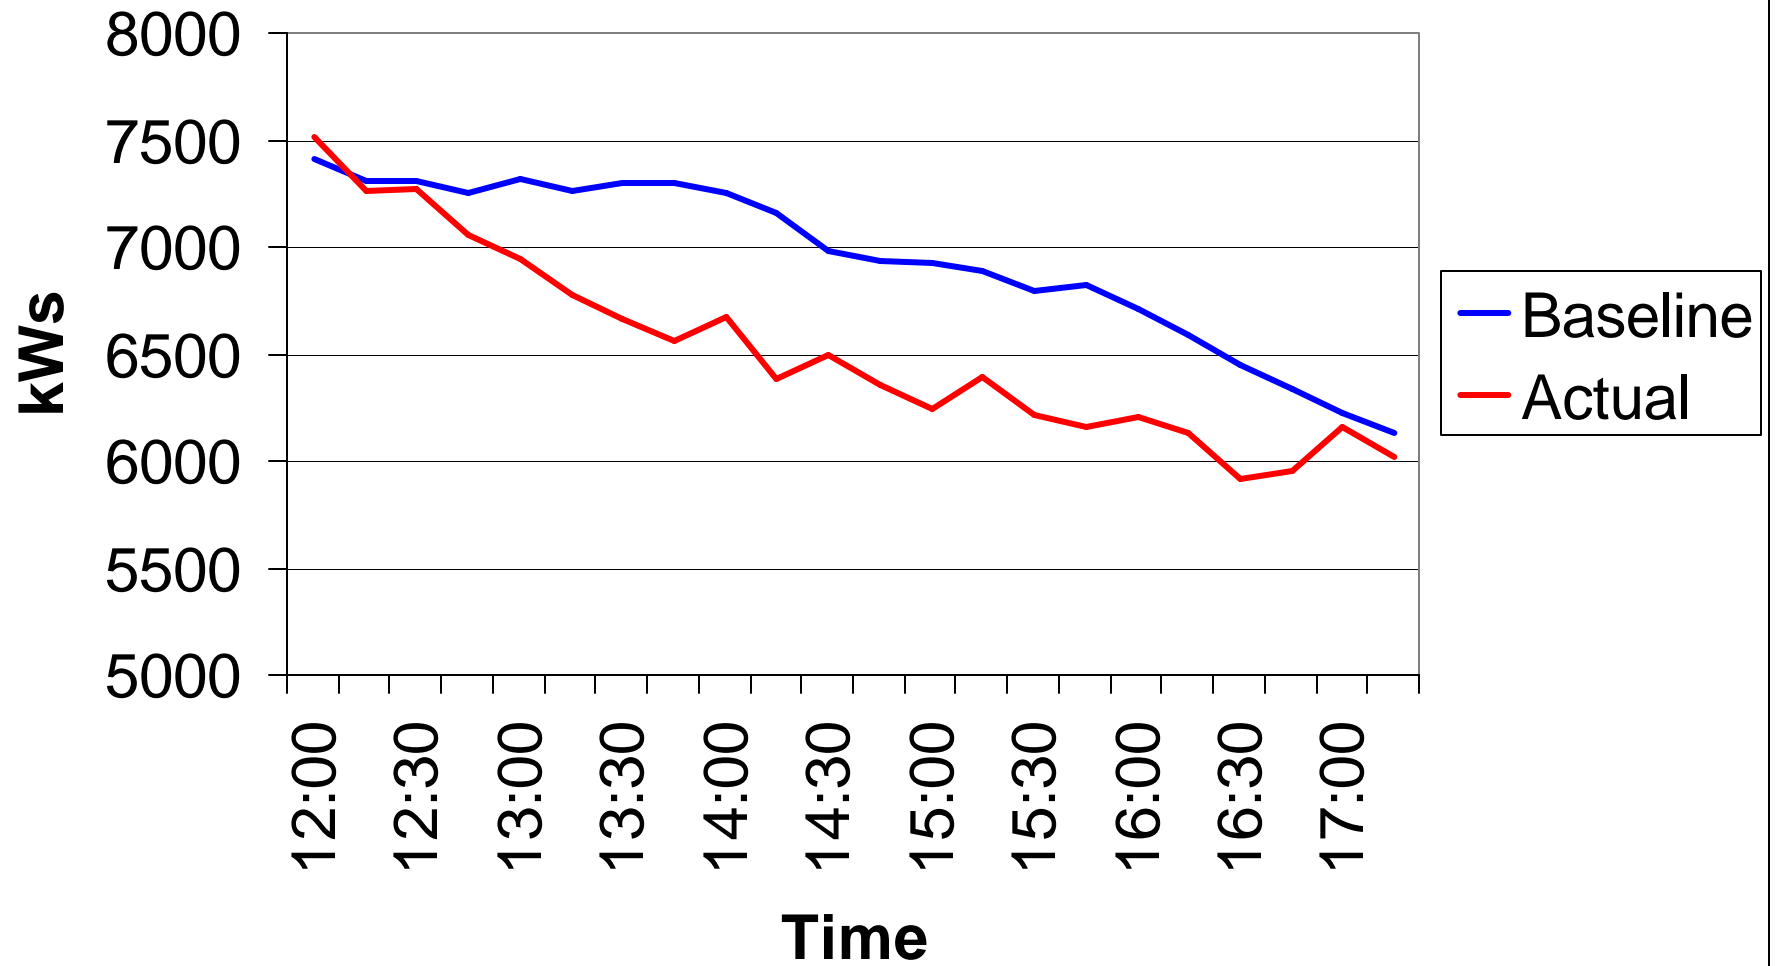

July 23rd Load Curtailment

